



DISTRICT BOARD
Megan Clark
Russ Greenfield
Larry Loder
Craig K. Murray
Judy Schriebman

DISTRICT ADMINISTRATION
Mark R. Williams,
General Manager
Michael Cortez,
District Engineer
Janice Mandler,
Collection System/Safety Manager
Susan McGuire,
Administrative Services Manager
Mark Von Aspern,
Plant Manager

ADDENDUM NO. 2

Date: December 30, 2011

Project: **CIVIC CENTER NORTH PUMP STATION AND
JOHN DUCKETT PUMP STATION
STANDBY GENERATOR REPLACEMENT PROJECT**

Job No.: 10300-11/-09

To: All Planholders and Prospective Bidders

The following attached changes and/or clarifications are hereby made to the Contract Documents, and shall become a part of the Bidding Documents.

This addendum consists of 6 sheets including this page. Acknowledge receipt of this addendum in the space provided on Page 2-5, and by signing in the space below. Submit a signed copy of this addendum along with the Bid. Failure to do so may result in rejection of the Bid.

Las Gallinas Valley Sanitary District:

Bidder: _____

Michael Cortez, PE
District Engineer
Tel. No. (415) 472-1033, ext. 18

(Authorized Signature) (Date)

X:\PROJECTS\10000 Projects\10300-09 -11 Civic Center and Duckett PS Generator Replacements\Addendum\10300-1109 7970 Addendum 2.docx

PLANS

1. Sheet 3 of 18 CIVIC CENTER NORTH PUMP STATION FLOOR PLAN, SECTION AND DETAILS

The attached Addendum Sketch 7970-Add2-A shall modify sheet 3 of 18.

2. Sheet 16 of 18, E-6 ELECTRICAL DUCKETT ONE LINE DIAGRAM

Delete the note: “(N) Portable Generator Receptacle-400A” and “400A Manual Transfer Switch” A portable generator receptacle and manual transfers switch already exists and will not be replaced with new units.

3. Sheet 17 of 18, E-7 ELECTRICAL DUCKETT ELECTRICAL PLANS

Delete the note: “(N) 400 A Portable Engine Generator Receptacle See Specs”. A portable engine generator receptacle and manual transfer switch already exist and will not be replaced with new units.

SPECIFICATIONS

1. Page 1-50, GENERAL CONDITIONS, 8.13 Guaranty

Change the sentence: “ The Contractor guarantees all of the Work for three years from the date the District accepts the Work. ”.

2. Page 01010-1, Section 01010, 1.02 A. WORK INCLUDED IN THIS CONTRACT, Civic Center North Pump Station, Item 6,

Change the sentence: “ Install SCADA” to read “Provide control and instrumentation wiring and connections as shown on the plans”.

3. Page 01010-2,Section 01010, 1.02 A. WORK INCLUDED IN THIS CONTRACT, John Duckett Pump Station, Item 7,

Change the sentence: “Install SCADA” to read “ Provide control and instrumentation and connections as shown on the plans”.

4. Page 16052-4, Section 1.08 WARRANTY, Item A.

Change the sentence: “The manufacturer shall warrant the material and workmanship of the generator set for a minimum of five (5) years from registered commissioning and start-up, or eighteen (18) months from date of shipment”, to read “The manufacturer shall warrant the material and workmanship of the generator set for a minimum of five (5) years from registered commissioning and start-up.”

CIVIC CENTER NORTH PUMP STATION AND JOHN DUCKETT PUMP STATION
STANDBY GENERATOR REPLACEMENT PROJECT
December 30, 2011

Page 3
Addendum No. 2

5. Page 16050-2, Section 2.02 WIRE AND CABLE, Item A.

Change the first sentence: "All wire shall bear UL label and be stranded copper, Type TXXN, 600 Volt, except that THW shall be used where indicated." To read: "All wire shall bear UL label and be stranded copper, Type THHN, 600 Volt, unless noted otherwise."

6. VOLUME 2 Page 2-7 SCHEDULE OF BID ITEMS, BID ALTERNATE

Replace the entire page 2-7 and 2-8 with the following two pages:

CIVIC CENTER NORTH PUMP STATION AND JOHN DUCKETT PUMP STATION
 STANDBY GENERATOR REPLACEMENT PROJECT
 December 30, 2011

Page 4
 Addendum No. 2

SCHEDULE OF BID ITEMS

Item No.	Estimated Quantity And Unit	Item Description Unit Price (Written in Words)	Unit Price (Figures)	Extended Amount (Figures)
1.	1 LS	Mobilization & Demobilization		\$ _____
		Lump sum		
2.	1 LS	Installation of New Engine Generator Set at Civic Center North Pump Station		\$ _____
		Lump sum		
3.	1 LS	Installation of New Engine Generator Set at John Duckett Pump Station		\$ _____
		Lump sum		
4.	1 LS	Sheeting, Shoring and Bracing		\$ _____
		Lump sum		

TOTAL BASE BID, BASIS OF AWARD (Items 1 thru 4 inclusive, & all work incidental thereto or connected therewith.)

\$ _____

BID ALTERNATE

The undersigned Bidder offers to make, at the following Bid Alternate price, the change in the Work covered by the Total Base Bid that is specified in the Bid Alternate priced below.

It is understood that:

1. The Bid Alternate price must be filled in.
2. The acceptance or rejection of the Bid Alternate is at the option of the District.
3. Acceptance or rejection of the Bid Alternate will not necessarily be made on the basis of price alone.
4. The acceptance or rejection of the Bid Alternate will not affect the Total Base Bid or other conditions of this Bid.


CIVIC CENTER NORTH PUMP STATION AND JOHN DUCKETT PUMP STATION
STANDBY GENERATOR REPLACEMENT PROJECT
December 30, 2011

- 5. The original Total Base Bid, without addition shown herein, would be the basis of award.
- 6. The addition shown herein for the Bid Alternate is the net adjustment that is to be applied to the Total Base Bid when calculating the Contract Price if the Bid Alternate is accepted by the District.
- 7. The final Contract Price shall be the net amount determined by applying the Total Base Bid and any adjustment made by the District regarding the Bid Alternate.

Bid Alternate: Install portable pump concrete slab and buried discharge piping with cathodic protection, relocation of existing crane beam and supports, painting and installation of new manual stainless steel hoist, modify existing concrete retaining wall and new guardrail as shown on the plans and as specified, all painting specified, including all Contractor and Subcontractor work incidental thereto or connected therewith.

Add: \$ _____
(in figures)

(in words)

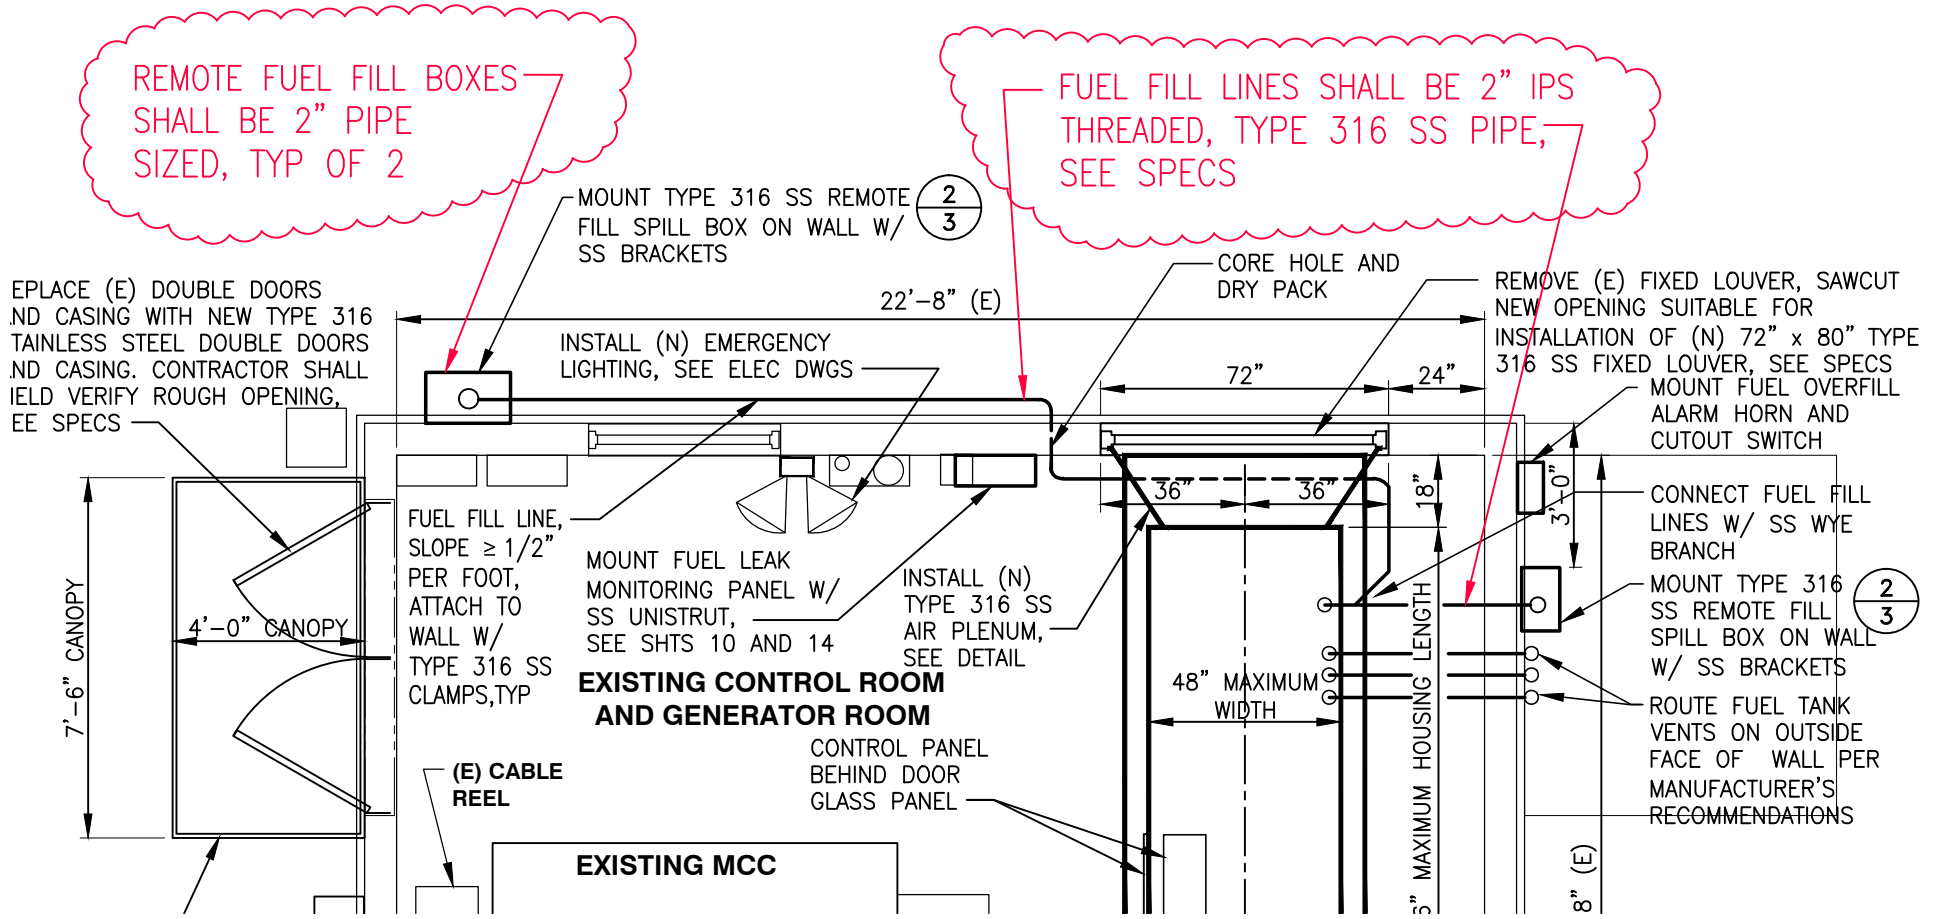

FLOOR PLAN
NOT TO SCALE

LAS GALLINAS VALLEY SANITARY DISTRICT
CIVIC CENTER NORTH P.S.
ENGINE GENERATOR FUEL PIPING

12/30/11

ADDENDUM SKETCH 7970-ADD2-A